


SECTION A - A.

NOTES: A drop manhole shall be constructed in sanitary sewers wherever the distance between the inverts is 2.0 ft. or greater. General manhole details refer to sheet no. 4-27.

The following notes on the Precast Concrete manholes shall pertain to the Drop Manhole: Top or Transition openings in riser sections. Joint Seal, Materials and Landing Platforms.

Poured in place concrete shall be 3000# Concrete. Core bore seals shall meet ASTM C-923 and C-167.

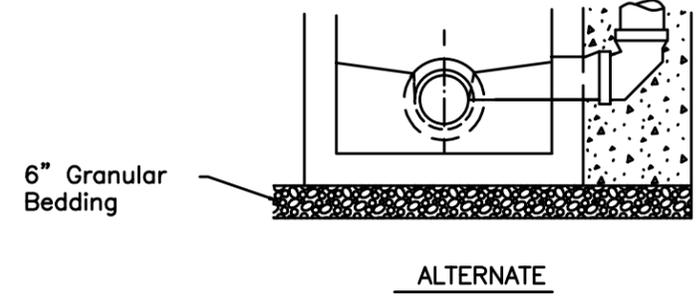

NOTE: This bedding with precast base on manhole.

PRECAST CONCRETE  
DROP MANHOLE

REVISIONS:

SCALE  
NO SCALE

DATE : DEC. 1998

UNIFORM STANDARDS: CLEVELAND --- CUYAHOGA COUNTY --- NORTHEAST OHIO REGIONAL SEWER DISTRICT